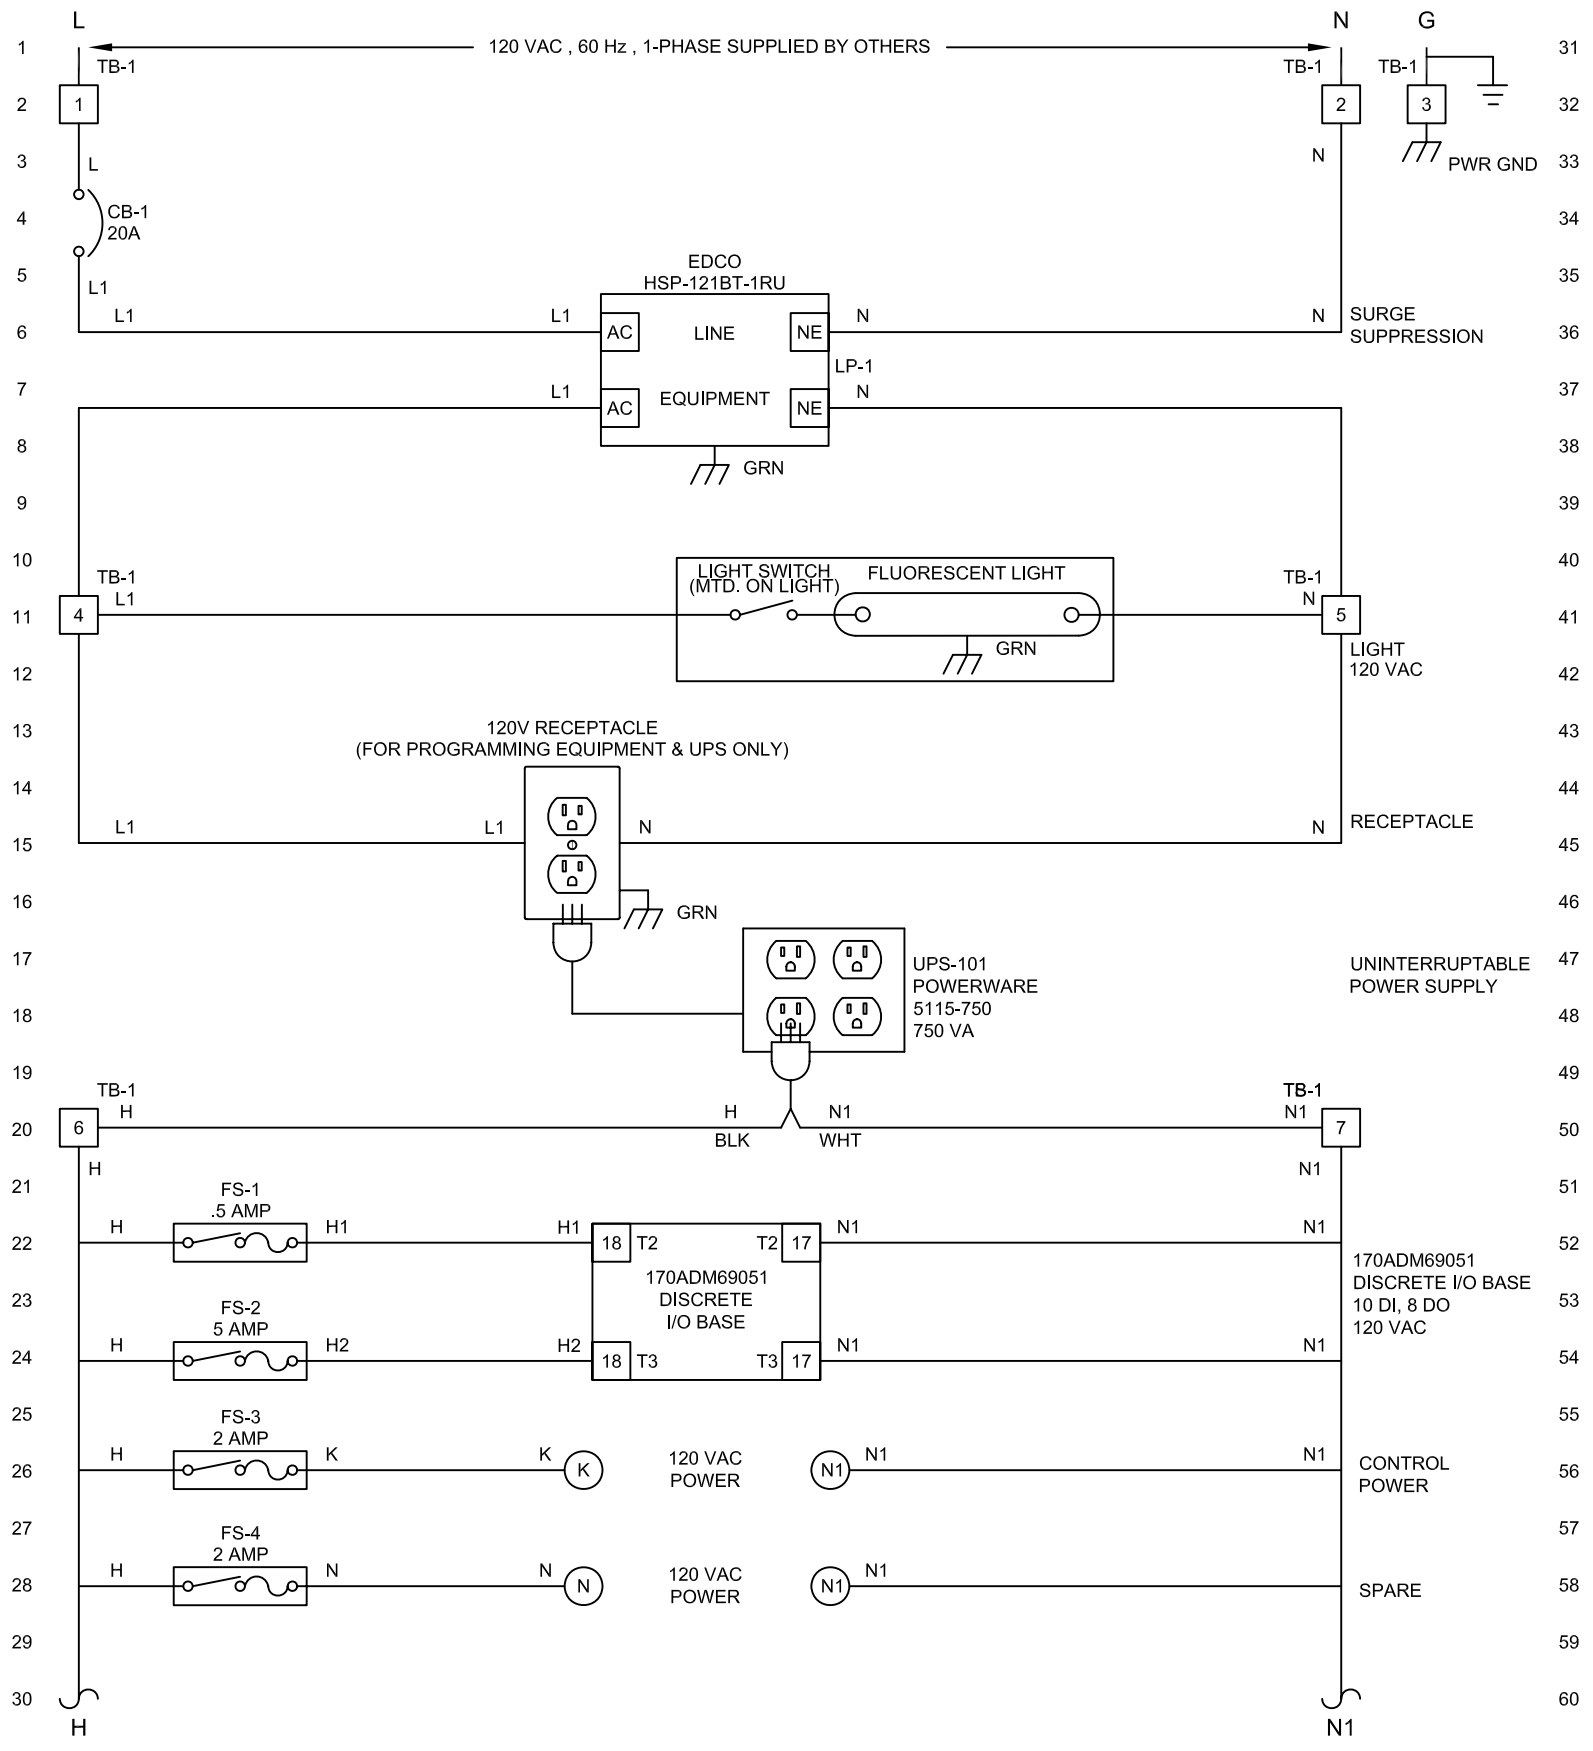

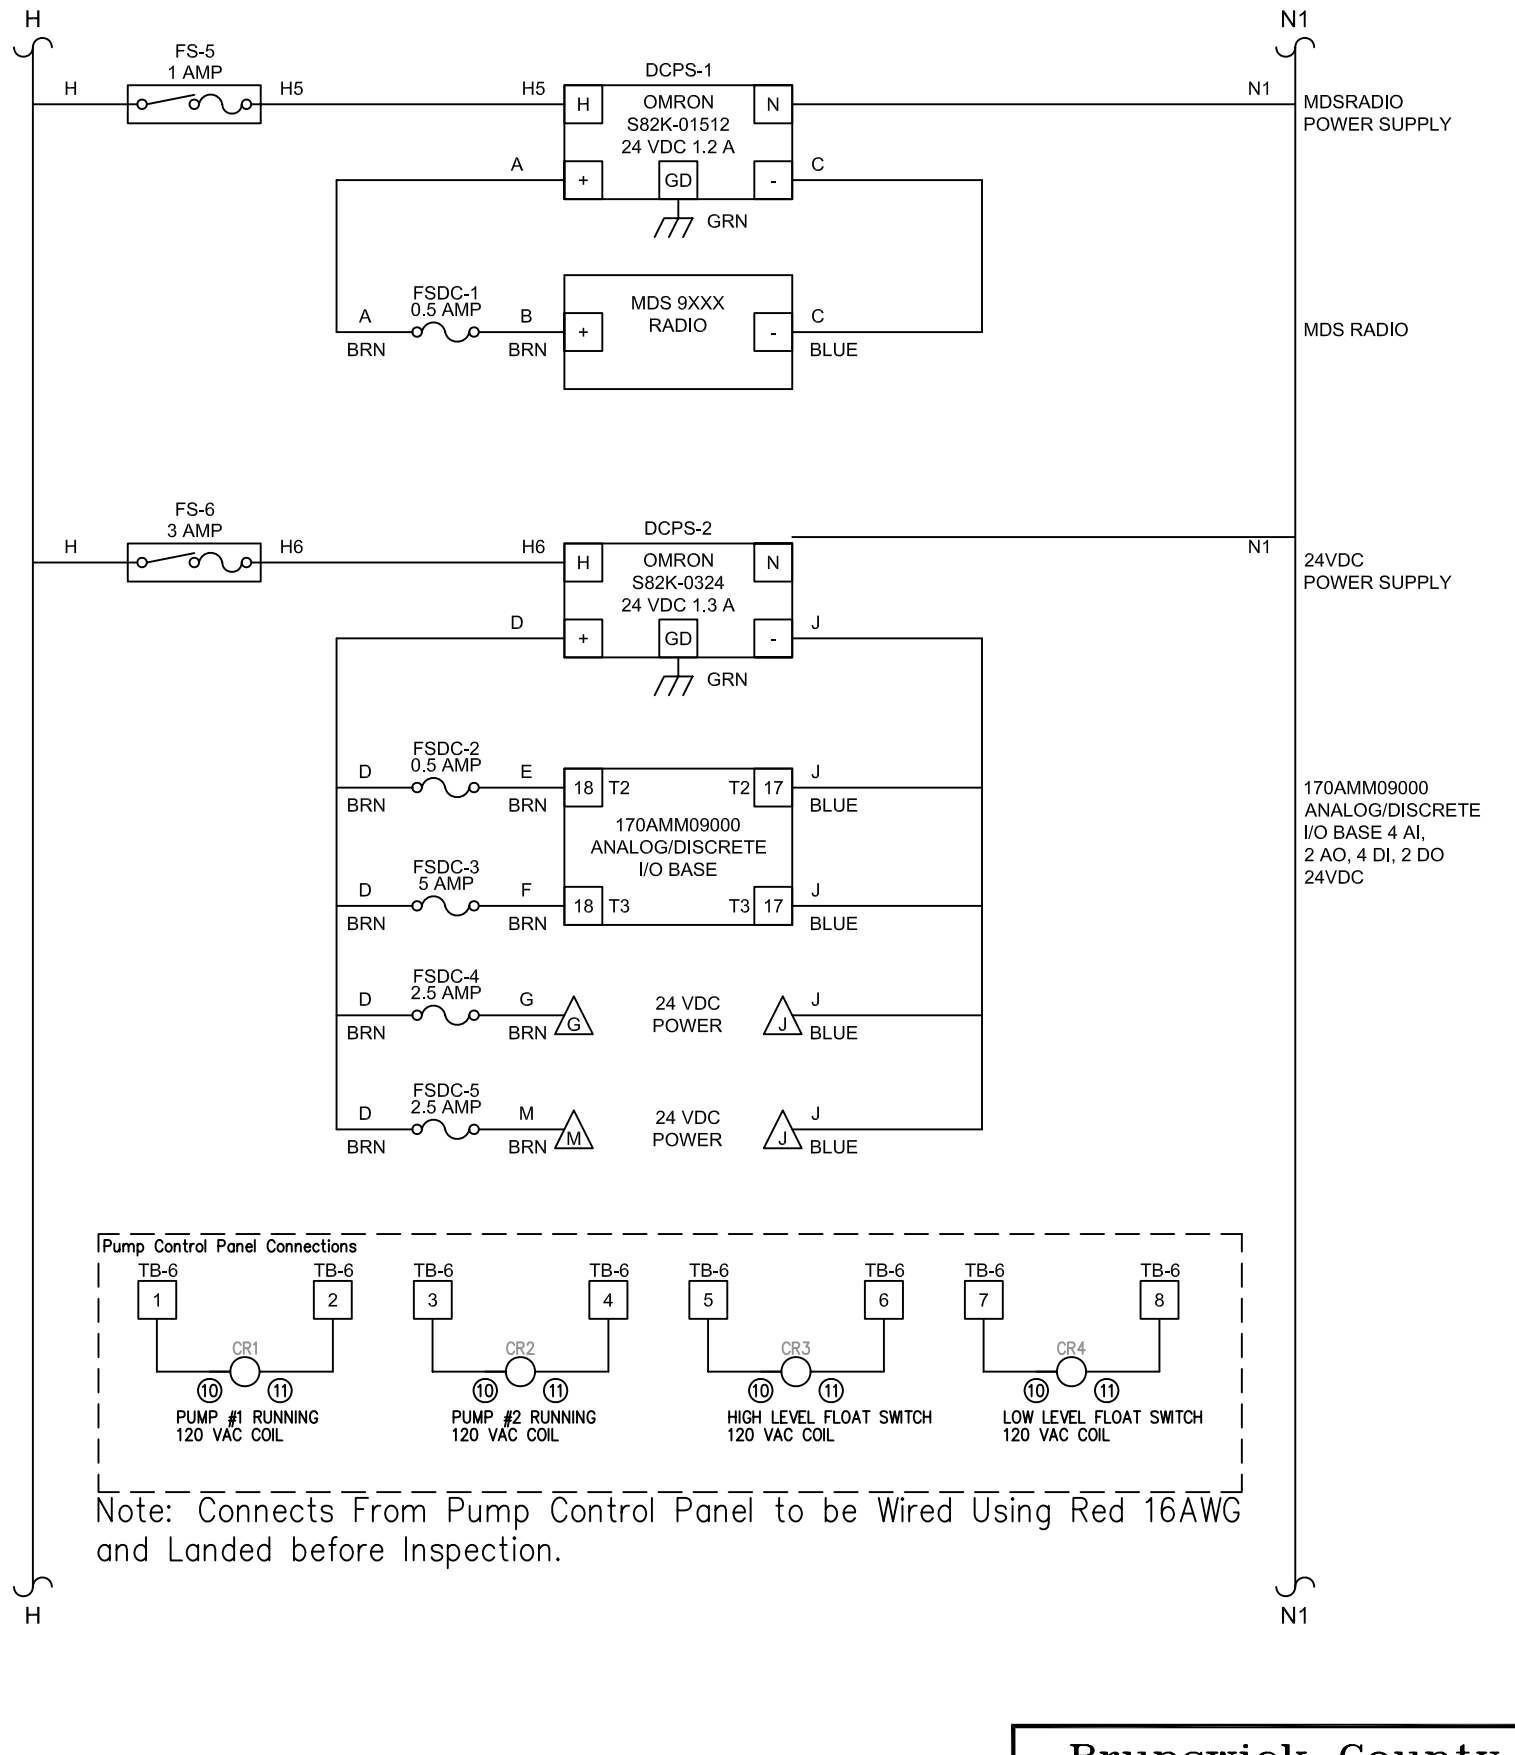

Note: Connects From Pump Control Panel to be Wired Using Red 16AWG and Landed before Inspection.

NO.	REVISION	DATE	APPROVED BY

Brunswick County

DATE	DESIGN BY	ENGINEER	SCALE
05/15/07	S.T.E		NONE

TITLE–DESCRIPTION
SEWAGE LIFT STATION
RTU CONTROL PANEL DETAIL

PROJECT	DRAWING NUMBER
BRUNSWICK CO. SCADA SYSTEM	ELAD_01