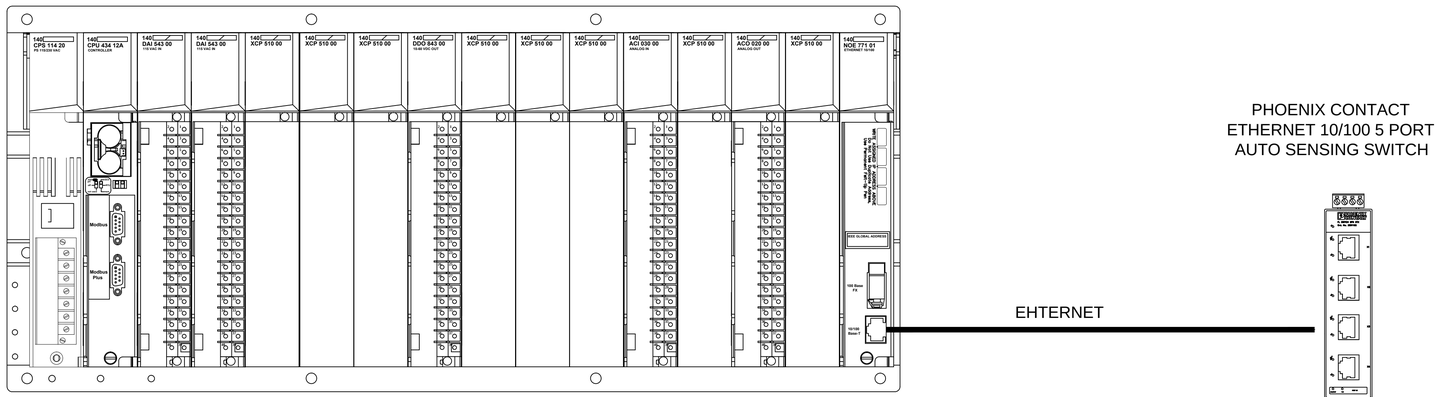

PLC LAYOUT

EHTERNET

PHOENIX CONTACT
ETHERNET 10/100 5 PORT
AUTO SENSING SWITCH

EHTERNET

C-MORE TOUCH SCREEN 10"

Revisions

1.1 - DATED 7/12/2013
Updated Touch Screen
1.2 - DATED 11/10/2016
Added Sheet 10 of 11

COUNTY OF BRUNSWICK

RTU / CONTROL PANEL
PUMPS LARGER THAN 50 HP
UTILIZING VFD'S
FOR
BRUNSWICK COUNTY
NORTH CAROLINA

Date: 05-22-12
Scale: NTS
Drawn By: JDM
Checked By: WLP