FIELD | PANEL

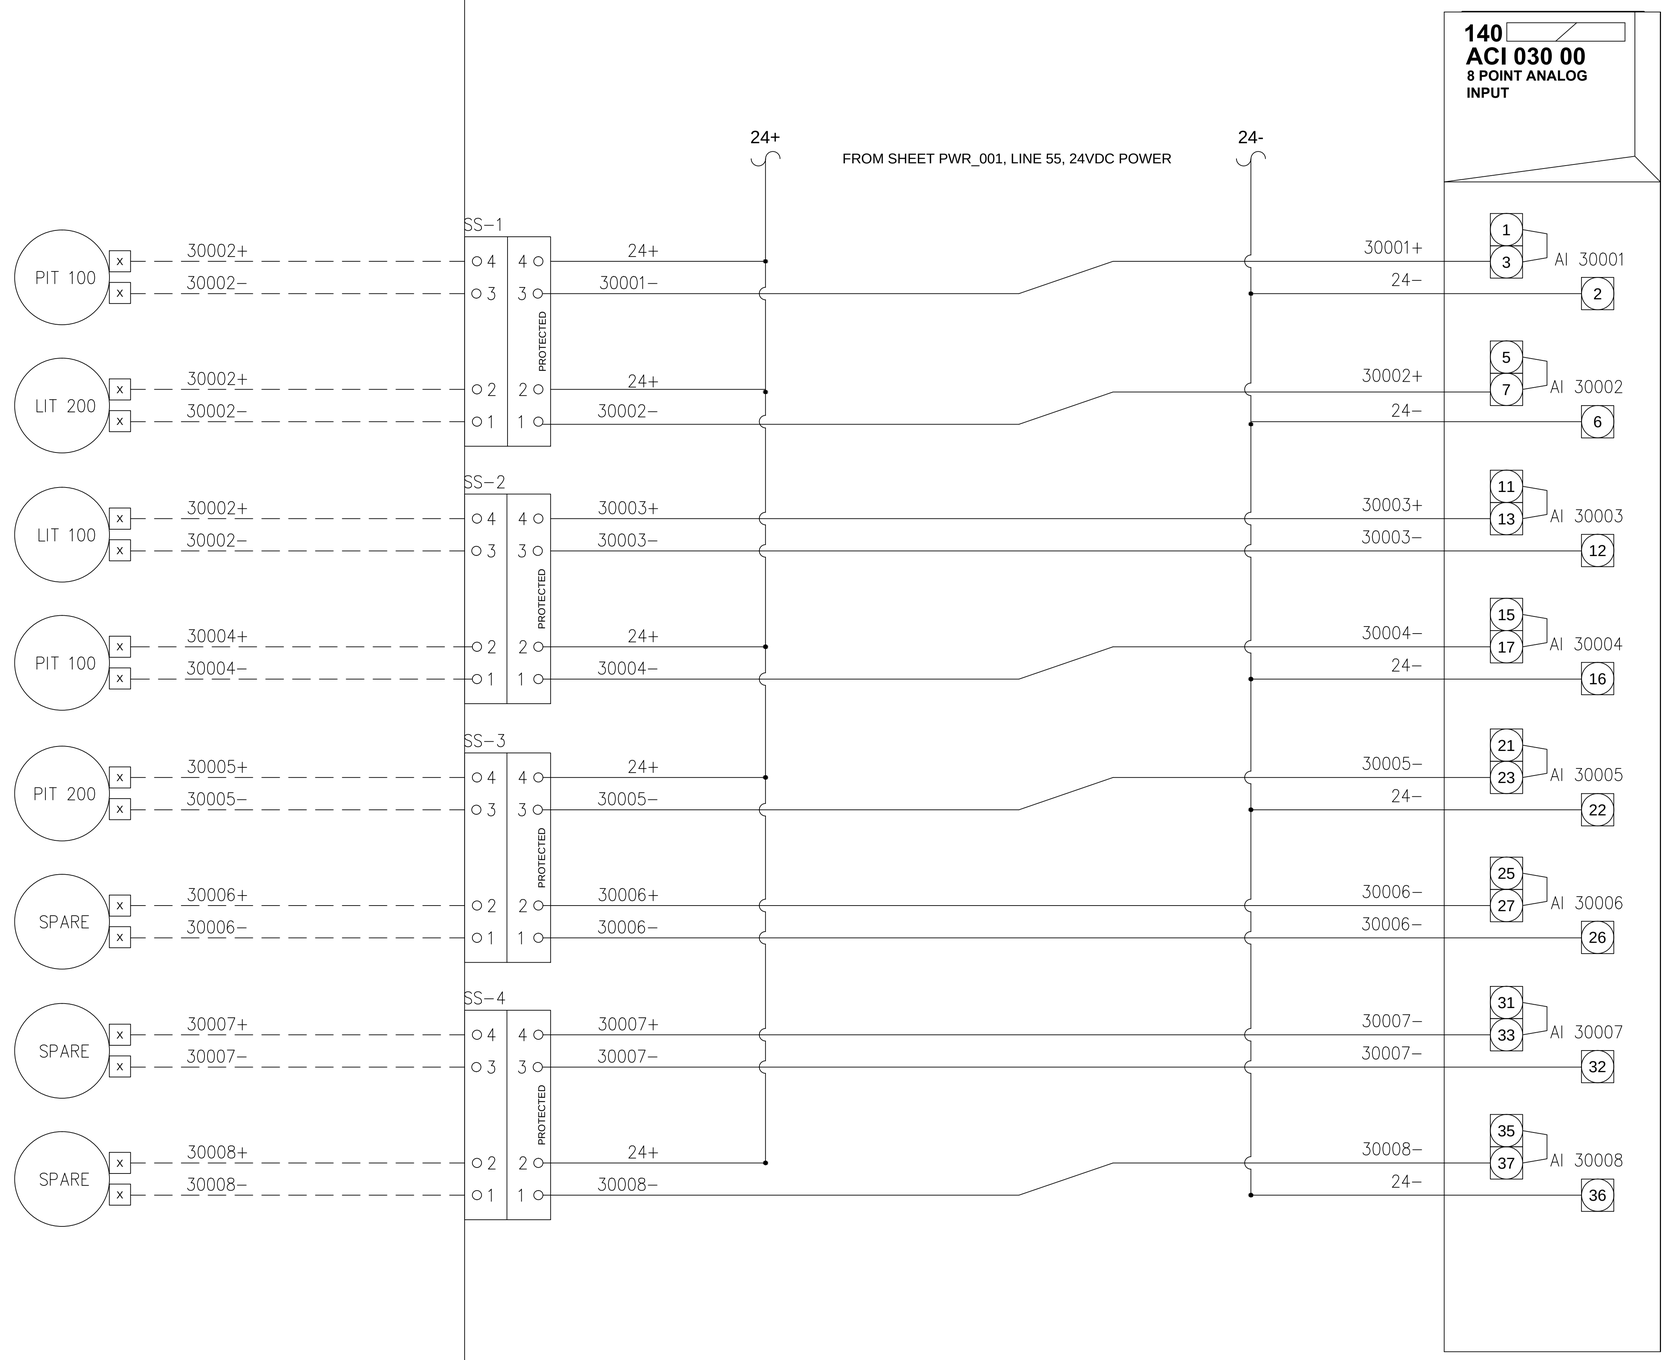

MODEL: IS-21
MANUF: WIKA
RANGE: 0-200 PSI
DISCHARGE PRESSURE

MODEL: SUB. TRANSDUCER
MANUF: DWYER
RANGE: 0-XX FT
WETWELL LEVEL

PUMP NO.1 VFD
SPEED FEEDBACK
0-100%

PUMP NO.2 VFD
SPEED FEEDBACK
0-100%

MODEL: XXXX
MANUF: XXXX
RANGE: XXXX

MODEL: XXXX
MANUF: XXXX
RANGE: XXXX

MODEL: XXXX
MANUF: XXXX
RANGE: XXXX

MODEL: XXXX
MANUF: XXXX
RANGE: XXXX

Revisions

1.1 - DATED 4/29/2016
Chng. PT and LT lines
1.2 - DATED 11/10/2016
Added Sheet 10 of 11

COUNTY OF BRUNSWICK

RTU / CONTROL PANEL
PUMPS LARGER THAN 50 HP
UTILIZING VFD'S
FOR
BRUNSWICK COUNTY
NORTH CAROLINA

Date: 05-22-12
Scale: NTS
Drawn By: JDM
Checked By: WLP