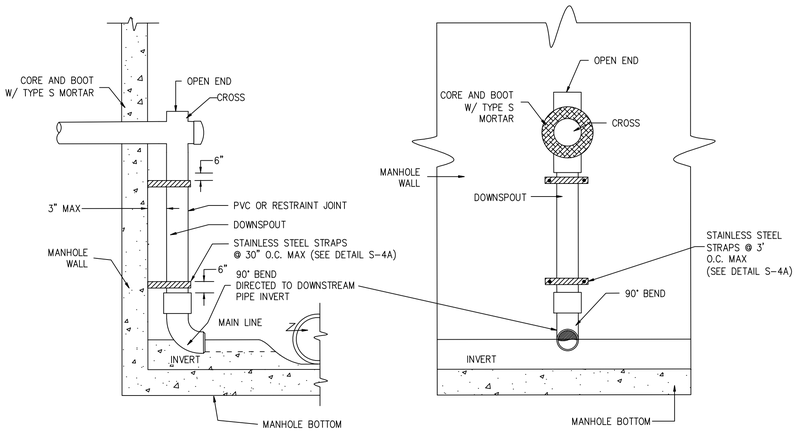

NOTES:

1. PIPING CONFIGURATION TO BE USED ON ALL DROPS ENTERING AT GREATER THAN 30" ABOVE BENCH.
2. FOR LOW PRESSURE SEWER CONNECTIONS, CROSS SHALL BE REPLACED BY A TEE (OPEN END UP).
3. FOR HIGH PRESSURE FORCE MAINS, CROSS SHALL BE REPLACED BY A 90° BEND.
4. LINE MAY NOT ENTER MANHOLE THROUGH CONE SECTION OR THROUGH ANY JOINT.
5. STAINLESS STEEL STRAPPING SHALL BE 1" WIDE BY ⅛" THICK AND ATTACHED TO THE MANHOLE WALL WITH STAINLESS STEEL MASONRY ANCHORS. FOR INTERIOR STRAPPING OF DROP PIPE, SEE DETAIL 7-A.

INSIDE DROP PIPING FOR MANHOLE DETAIL S-7

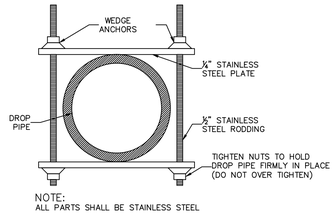

NOTE:
ALL PARTS SHALL BE STAINLESS STEEL

DROP PIPE STRAP DETAIL S-7A

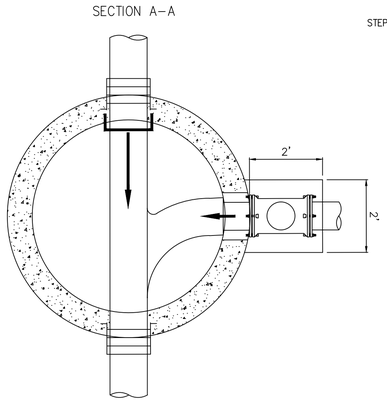

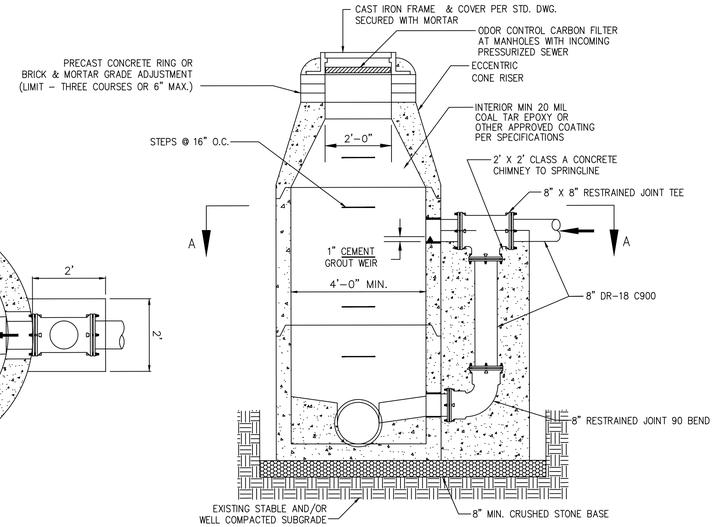

NOTES:

1. CONSTRUCT OUTSIDE DROP CONCRETE AND PIPING WITH EACH SECTION OF MANHOLE RISER.
2. DO NOT RETROFIT OUTSIDE DROP TO EXISTING MANHOLE. USE INSIDE DROP INSTEAD.
3. ALL OUTSIDE DROP SANITARY SEWER MANHOLES MUST BE APPROVED BY BRUNSWICK COUNTY ENGINEERING.
4. ALL EXTERIOR JOINTS SHALL BE SEALED WITH A 4" WIDE BUTYL RUBBER WRAP.

PRECAST MANHOLE WITH OUTSIDE DROP DETAIL S-8

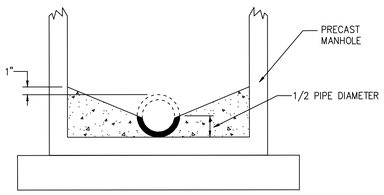

SECTION "A-A"

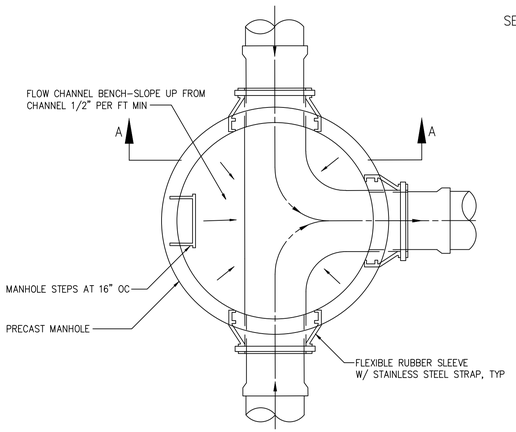

PLAN

TYPICAL MANHOLE INVERTS DETAIL S-9

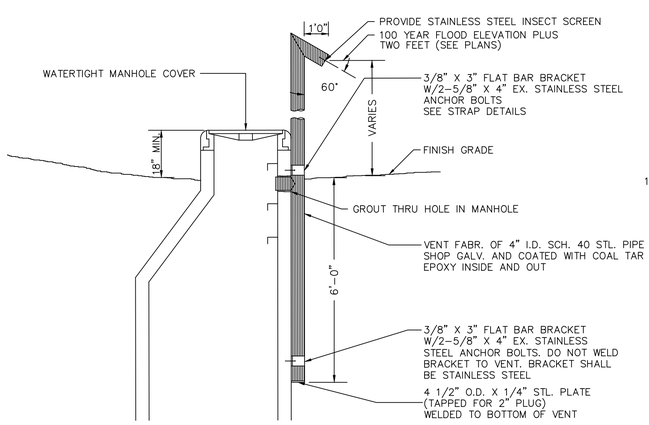

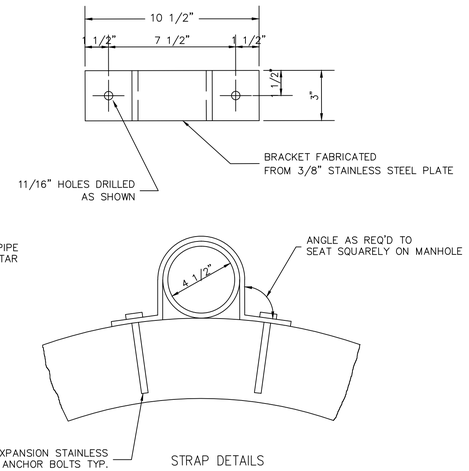

MANHOLE VENTING FOR FLOODPLAIN AREAS DETAIL S-10

Revisions

1.1 - DATED 4/30/2013
Mod S-7, Add. S-7A
1.2 - DATED 1/23/2019
Mod S-7, S-8

COUNTY OF BRUNSWICK

GENERAL SEWER DETAILS
FOR
BRUNSWICK COUNTY
NORTH CAROLINA

Date: 06-18-12
Scale: NTS
Drawn By: JDM
Checked By: WLP